
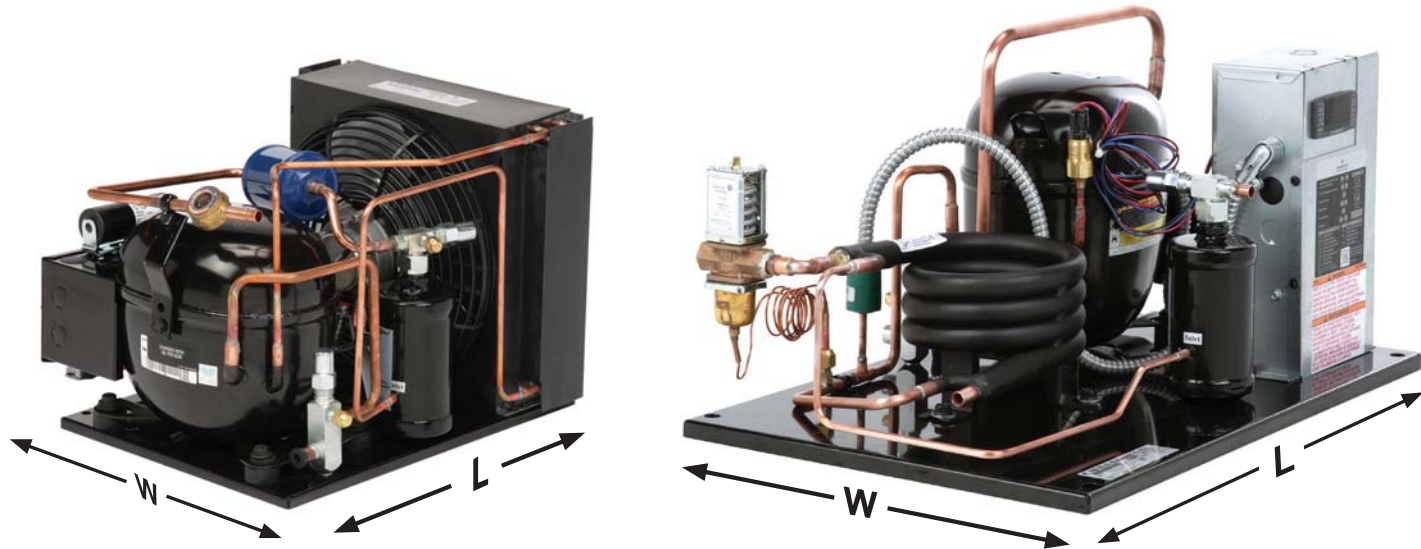


Nomenclature • M-Line Units

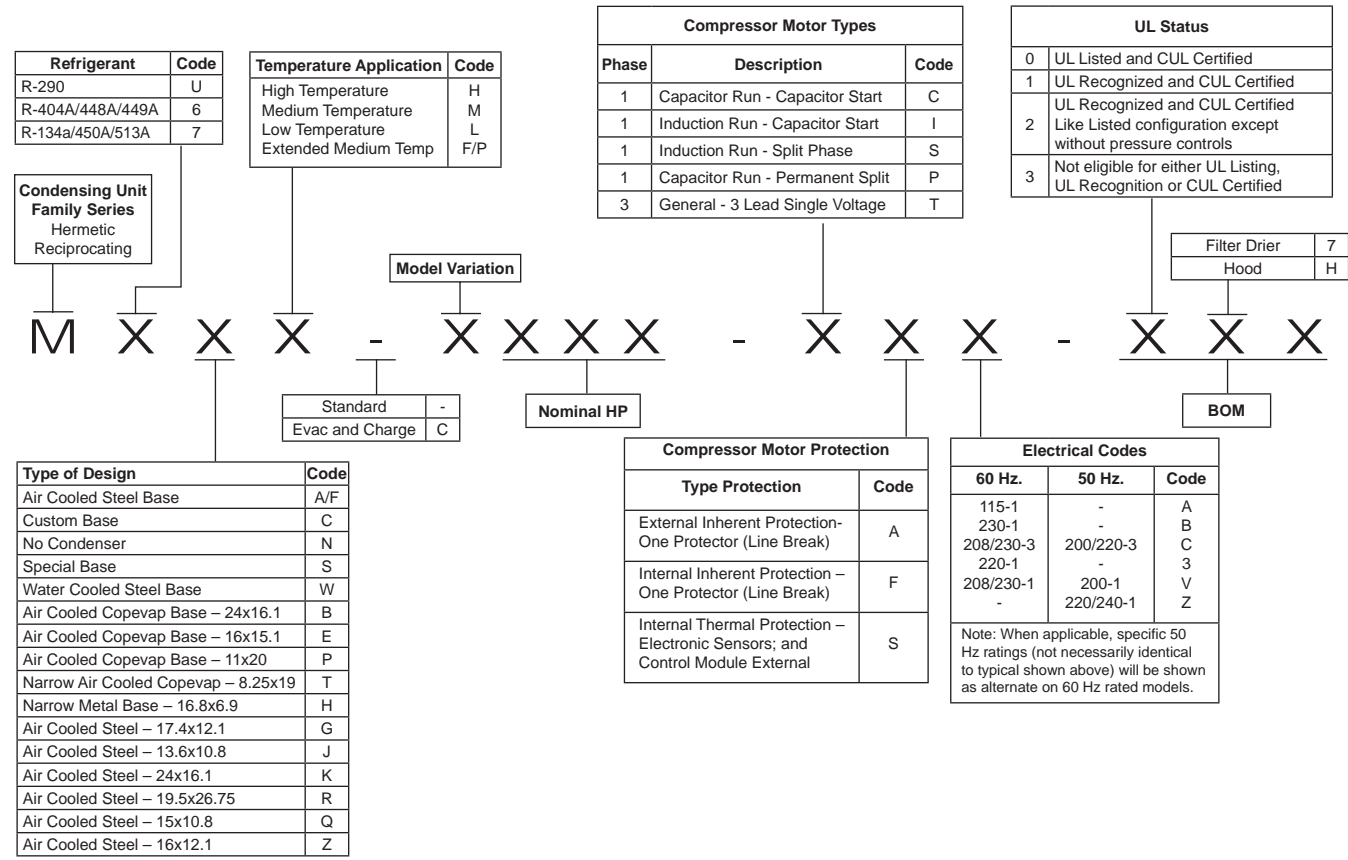

Bill of Materials Matrix

Features	Steel Base Standard BOMs		Condensate Base Standard BOMs						
	Air Cooled	Water Cooled	E Base		T Base		B/P Base		
	177	179	020	103	111	108	118	177	179
Receiver W/ Valve	X		X	X			X	X	
Suction Valve	X	X	X	X	X			X	X
Liquid Base Valve		X			X				X
Fan Guard	X	X				X	X	X	X
End Covers						X	X		
Conduit			X						
Power Cord	X	X		X	X	X	X	X	X
Pressure Controls									
Filter Drier	X	X						X	X
Moisture Indicator	X							X	
Water Valve			X						
UL Listed			X						
UL Recognized	X	X		X	X	X	X	X	X

Optional BOMs									
	020	028*	212	072	078*	272			
Receiver	X	X	X	X	X	X			
Suction Valve	X	X	X	X	X	X			
Fan Guard	X	X	X	X	X	X			
End Covers	X	X	X	X	X	X			
Power Cord									
Filter Drier				X	X	X			
Moisture Indicator				X	X	X			
Pressure Control/EUC	X			X					
Conduit	X	X	X	X	X	X			
UL Listed	X	X		X	X				
UL Recognized			X			X			

* Units with a compressor RLA under 6A do not require pressure controls for UL listing. xx8 will identify units under 6A that are listed, but do not have pressure controls.